

PANEL:Form Water Ripple Panels - Installation Instructions

General Information

- PANEL: Form Water Ripple panels are downward accessible panels made from 0.6 – 3.0 mm thick 304 stainless steel, design dependent. The water ripple patterns are fabricated by applying a stamping & cold drawing process that creates a unique light reflecting effect.
- Offered in traditional and custom panel styles, Water Ripple panels can be fabricated into ceilings, walls, column covers, escalator surrounds and more.
- Ceiling panels are designed to be installed with Maxxit's custom suspension systems or standard heavy duty 15/16" grid, pre slotted.
- Metal Ceilings are engineered for use in seismic areas when installed in accordance with local code requirements.

Site Conditions

- Install only after spaces are free of construction debris, enclosed, weather-tight, and after all wet work and overhead work have been completed.
- Interior panels are not to be used in exterior applications or high moisture environments where water comes in direct contact with the baffle.
- For exterior applications use exterior grade 316 stainless steel as specified by Maxxit.

Storage & Handling

- Do not store or install near an exposed flame, source of heat, or source of ignition.
- Store horizontally in the original carton in a dry, interior space. Clean gloves must be used to avoid fingerprints. When removed for install, panels should be stored in a flat, horizontal position.

Fire Performance

- Manufactured to meet ASTM E-84 Class 1 or A fire retardancy. Panels may interfere with fire sprinkler or fire detection system. Consult a fire protection engineer, NFPA 13, and their local code official for guidance on the proper installation.

Warranty

- A 1-year limited warranty is available. Please consult www.maxxitgroup.com for details.

Colors

- The panels surface is processed with a mirrored finish and PVD color
- Available in seven colors and six water ripple textures.

Cutting Panels

- PANEL:Form Water Ripple panels are made of T304 Stainless Steel. Due to the finish characteristics we recommend that panel cutting is performed by the manufacturer when possible.
- When field cutting is necessary Water Ripple panels can be cut with commonly available stainless steel fabrication tools.
- For straight cuts use a metal cutting circular saw with a non-ferrous metal cutting blade.


PANEL:Form Water Ripple Panels - Installation Instructions

Installing Panels

- Compress the torsion springs ends together and insert into the panel slots.
- Line up the panel springs with the slots in the main beam or cross tee, then compress the spring ends once again and insert into the main or tee.
- Press the panel in place. The springs will expand and hold the panel firmly in place


Removing Panels

- Use a T shape shaped hook tool inserted into the panel joints to hook the top of the panel and gently pull it down till the torsion spring catches.
- Compress the torsion spring ends and remove it from the Main or Tee.
- Remove two adjacent torsion springs and the panel will swing open in place.
- For plenum access leave the open panel in place to avoid damage or loss.

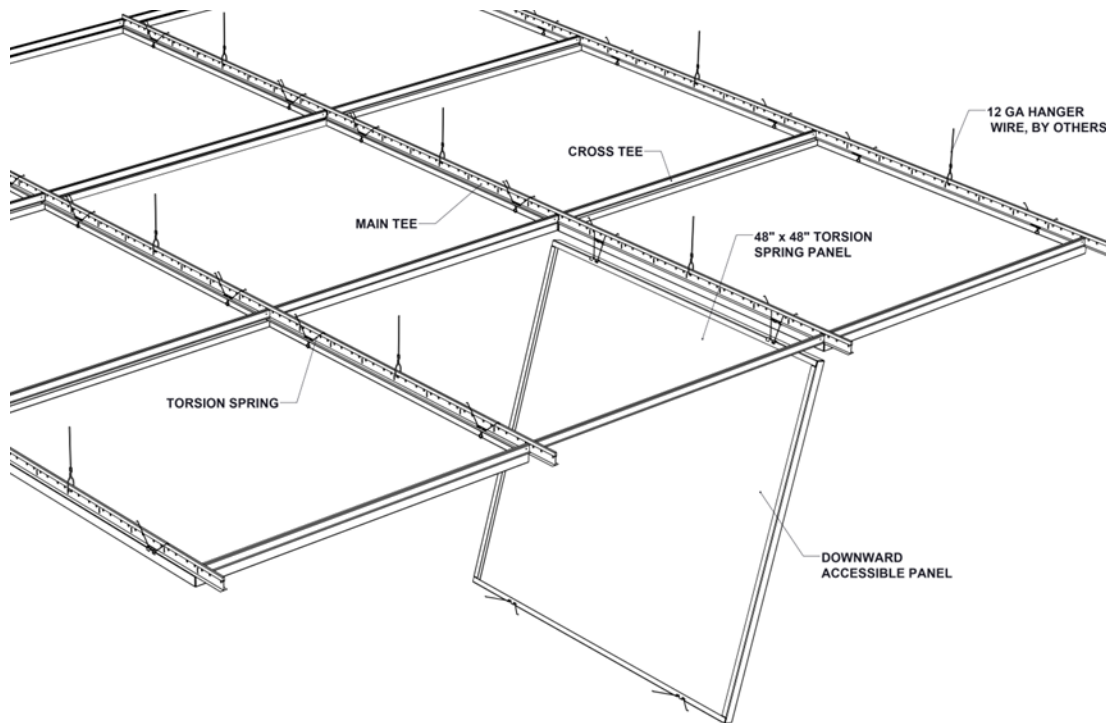

Ceiling Panels are downward accessible and designed to install on pre-slotted suspension grid 'Main Beams & Tees' using factory supplied torsion springs.

PANEL:Form Water Ripple Panels - Installation Instructions

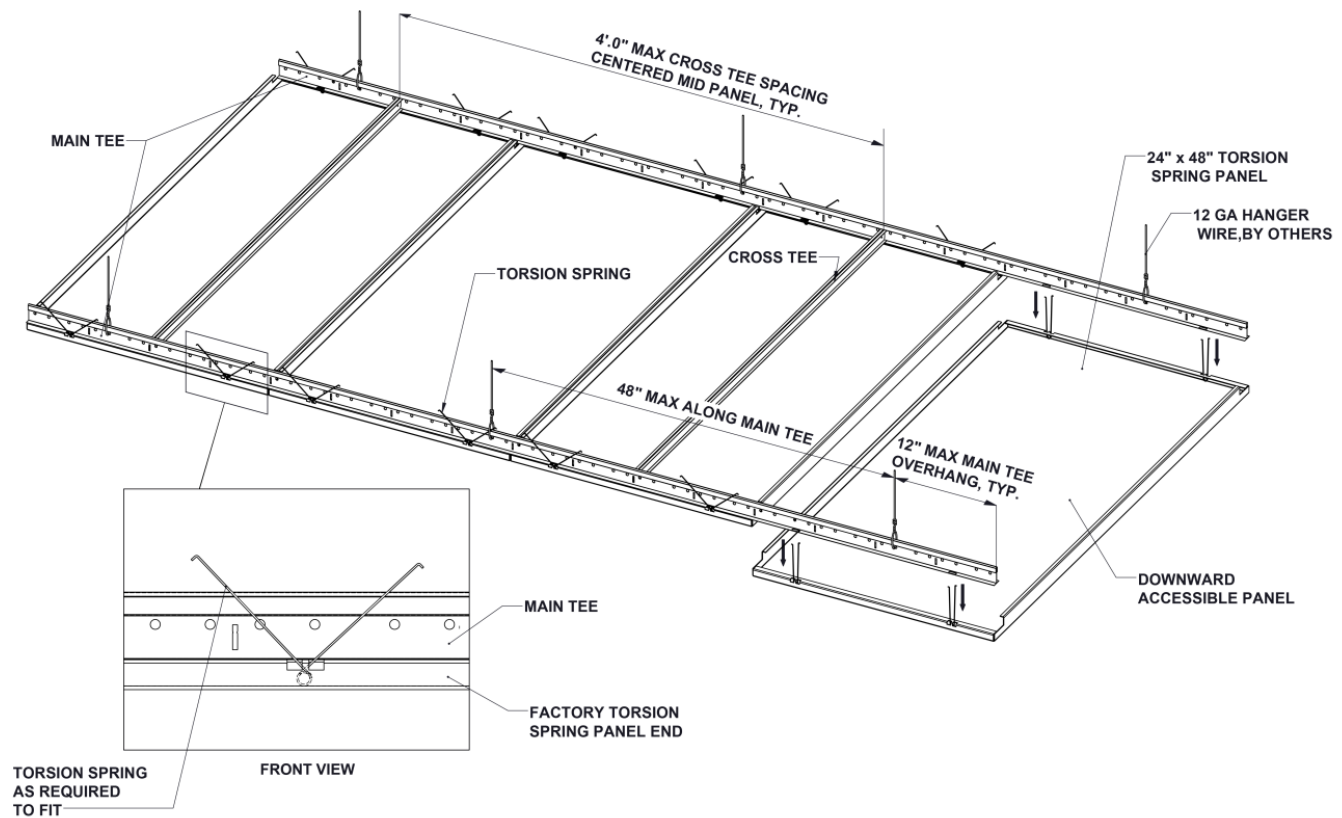

For 2'x2', 2'x4' & 2'x6' panels, torsion springs can be inserted into Main Beams and Tee's.

For 2'x8' and 30"x30" panels, torsion springs must be inserted into Main Beams only.

PANEL:Form Water Ripple Panels - Installation Instructions

MEP Integrations

- Mechanical fixtures such as lights and sprinklers can be installed at the suspension system height, flush with the panels. Fixture weight must not be supported by the panels or HD grid suspension.

Before installing, please note.

In addition to these instructions please refer to the publications referenced below for full details on industry accepted practices and requirements.

- CISCA "Ceiling Systems Handbook"
- Standard for Ceiling Suspension System Installations - ASTM C 636
- Standard for Ceiling Suspension Systems Requiring Seismic Restraint - ASTM E 580
- IBC (International Building Code) Standard for Seismic Zone for local area.

For addition question or assistance

Please contact us at: www.maxxitgroup.com